

The control and diagnostics facility is provided for single or multiple reception systems. The facility provides the following operator friendly facilities.

- A full display of systems operating and efficiency indicators.
- A manual control mode to allow safe operator intervention for recovering from an upset condition from a blocked line due to out of tolerance material or air failure.
- An alarm diagnostics display by various flashing sequence from the alarm lamp.
- A record of system operating performance from a data logging facility.

For further details please refer to Appendix H/1 dated May 1, 2001

Mactenn

A Macawber Group Company

ADVANCED PNEUMATIC CONVEYING & INJECTION SYSTEMS
VALVES FOR ABRASIVE MATERIALS AND PRESSURE DUTY
BATCH MIXING AND INGREDIENT CONTROL
COMPLETE BULK MATERIAL SYSTEM DESIGN AND TURNKEY SUPPLY



Mactenn


SYSTEMS LIMITED

Macawber Europe

INFORMATION SHEET 1-46 L2

LEVEL 2 STANDARD OPERATING CONTROLS WITH ALARM DIAGNOSTICS FACILITY - MINIMAXFLO + MAXFLO SYSTEMS

Mactenn

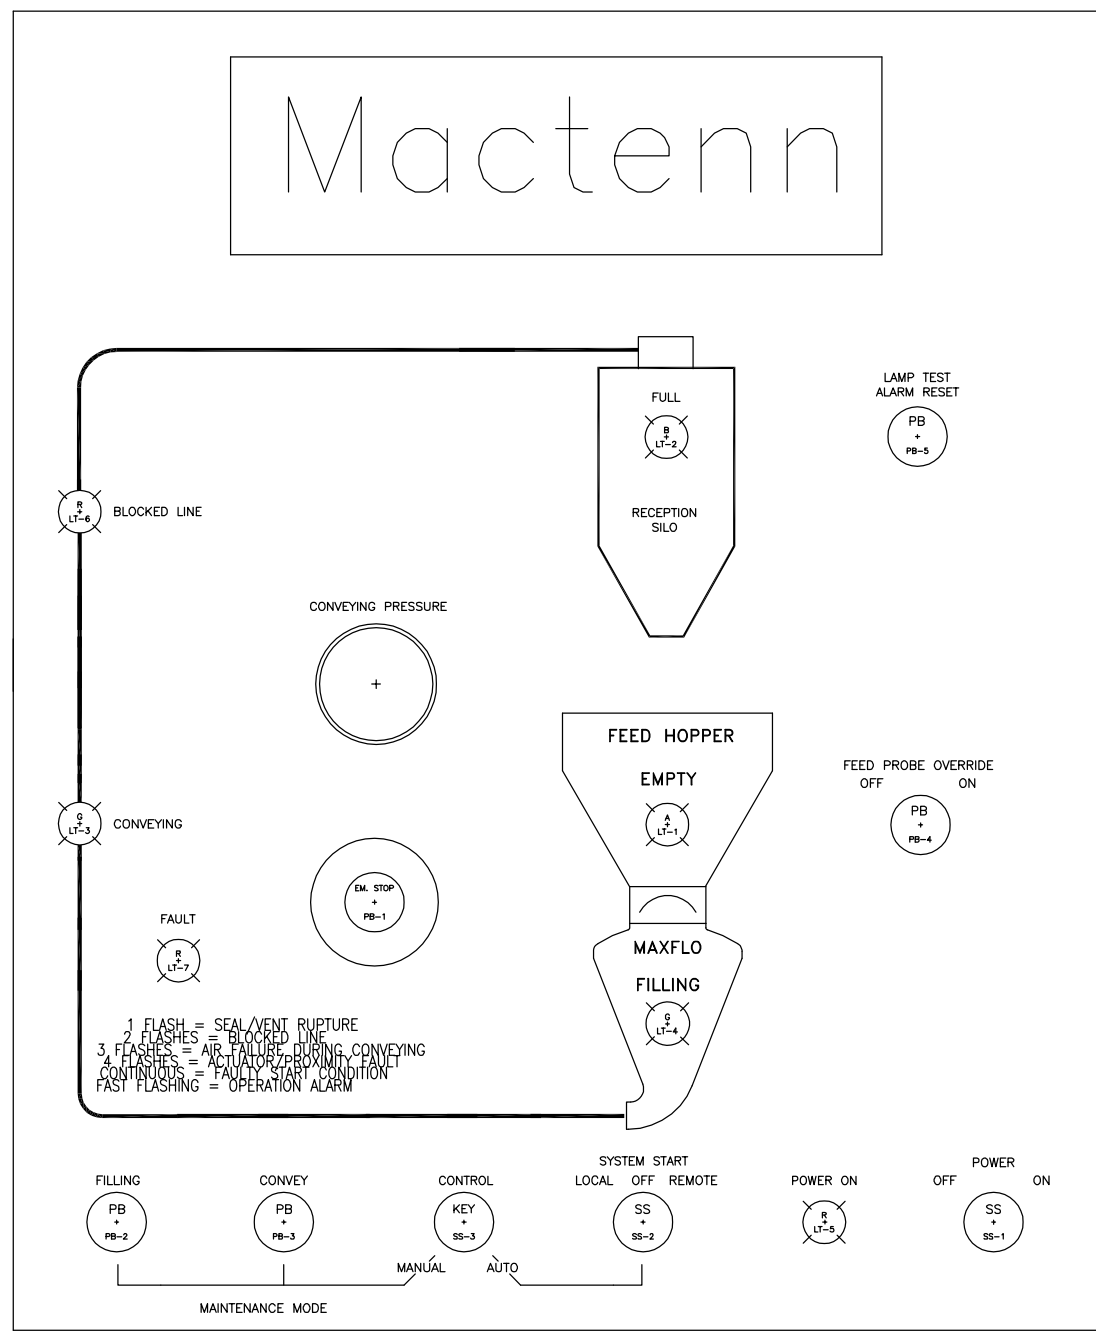

INFORMATION NOT CERTIFIED FOR INSTALLATION PURPOSES

Mactenn

A Macawber Group Company

ADVANCED PNEUMATIC CONVEYING & INJECTION SYSTEMS
 VALVES FOR ABRASIVE MATERIALS AND PRESSURE DUTY
 BATCH MIXING AND INGREDIENT CONTROL
 COMPLETE BULK MATERIAL SYSTEM DESIGN AND TURNKEY SUPPLY